

# ALL REBAR TO BE ENCASED IN 2" OF CONCRETE EXCEPT AT TOP 4"



**(OPTION #1)**  
ELECTRICAL CONNECTION WITH #4 COPPER WIRE OR PER DETAIL ON APPROVED PLANS COULD BE DONE IF NO REBAR STUBS UP THE WALL. CONNECTION MUST BE LISTED CONNECTOR. (LISTED FOR DIRECT BURIAL, CONCRETE ENCASED)


**(OPTION #2)**  
GROUND ROD OR NON-CORROSIVE BAR.

**(OPTION #3)**  
DETAIL IS FOR CONCRETE OR POURED WALLS. (MIN 8" IF USING STEM WALL) NOT MASONRY BLOCK WALLS UNLESS DETAIL IS ON APPROVED PLANS

#4 REBAR OR #4 COPPER ROD TO EXTEND 4" ABOVE POURED WALL AND TIE REBAR WITH STANDARD WIRE TIES

LISTED REBAR CLAMP

#4 MIN COPPER OR SIZED PER DRAWING GROUNDING ELECTRODE CONDUCTOR RAN TO ELECTRICAL SERVICE EQUIPMENT

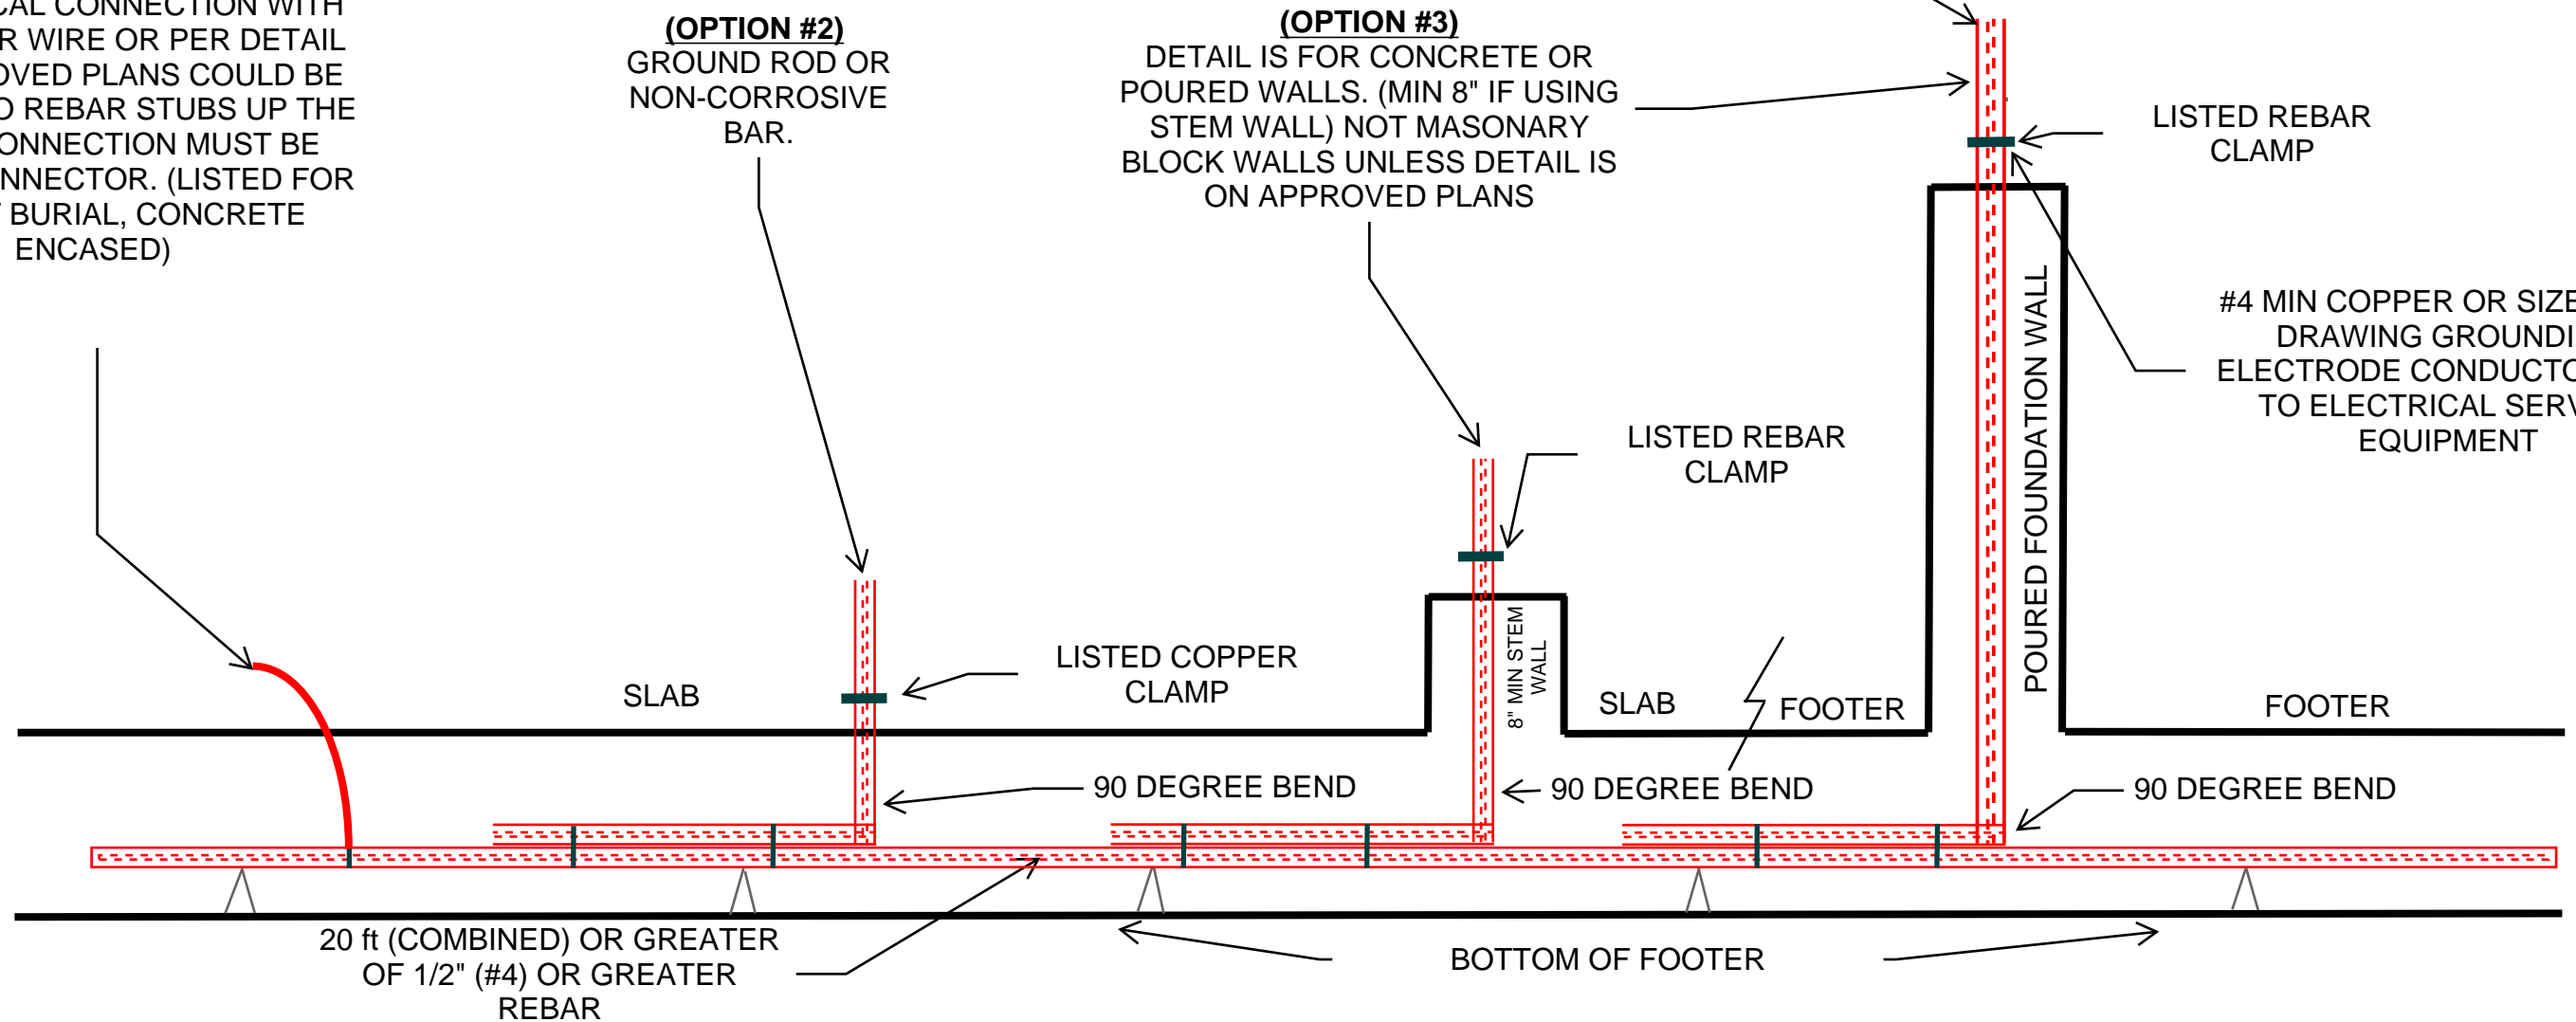

CONCRETE-ENCASED ELECTRODE (UFER) DETAIL AS PER NEC 250.52 (A) (3)