




** PLEASE VERIFY PROPER WIRE INSULATION TYPE

** CANNOT USE STANDARD U.S.E INSULATION TYPE WIRE
IN EITHER BUILDING




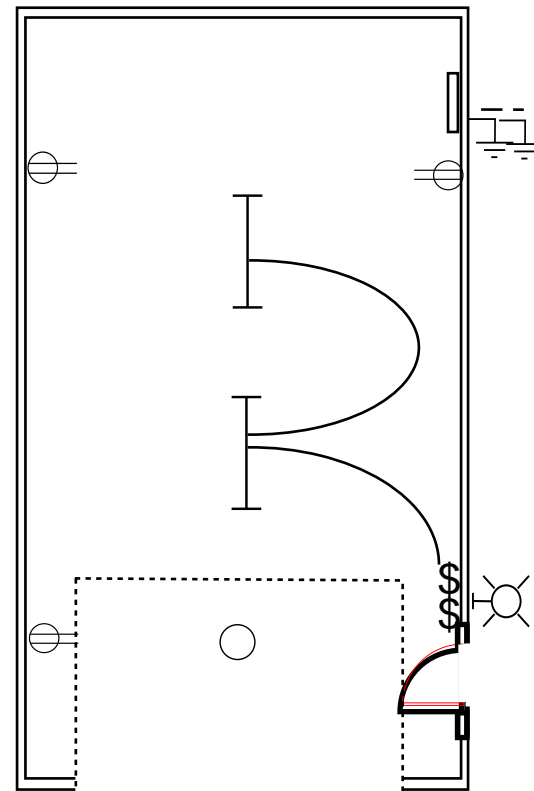




DETACHED ACCESSORY
STRUCTURE WITH
SUB-PANEL. GARAGE,
POLE BARN, PAVILION
ETC.



TRENCHED ELECTRIC
LINES: DIRECT BURY
24"/ IN CONDUIT 18"
(NEC TABLE 300.5)

WHERE A BRANCH CIRCUIT OR FEEDER
ORIGINATES IN THESE ADDTIONIONAL
BUILDINGS OR OTHER STRUCTURES,
ONLY ONE FEEDER OR BRANCH CIRCUIT
SHALL BE PERMITTED TO SUPPLY POWER
BACK TO THE ORIGINAL BUILDING OR
STRUCTURE, UNLESS PERMITTED IN THE
225.30 (A) THROUGH (F)

RESIDENCE

- SUB-PANEL BRANCH FEEDER (SEE NOTES)
-  SUB-PANEL GROUNDING ELECTRODE
-  SUB PANEL
-  SERVICE
-  SWITCH
-  CEILING MOUNTED LIGHT FIXTURE
-  CEILING OUTLET
-  OUTLET
-  SWITCHED LIGHT FIXTURE

DETACHED ACCESSORY STRUCTURE WITH ELECTRIC SUB-PANEL