




\*\* PLEASE VERIFY PROPER WIRE INSULATION TYPE  
 \*\* CANNOT USE STANDARD U.S.E INSULATION TYPE WIRE  
 IN EITHER BUILDING


DETACHED ACCESSORY  
 STRUCTURE WITH OUT  
 SUB-PANEL. GARAGE,  
 POLE BARN, PAVILION  
 ETC.



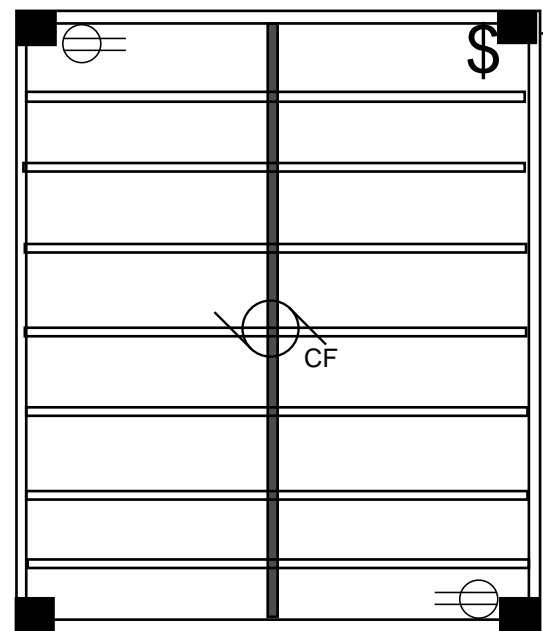





TRENCHED ELECTRIC  
 LINES: DIRECT BURY  
 24" / IN CONDUIT 18"  
 (NEC TABLE 300.5)

WHERE A BRANCH CIRCUIT OR FEEDER  
 ORIGINATES IN THESE ADDITIONAL  
 BUILDINGS OR OTHER STRUCTURES,  
 ONLY ONE FEEDER OR BRANCH CIRCUIT  
 SHALL BE PERMITTED TO SUPPLY POWER  
 BACK TO THE ORIGINAL BUILDING OR  
 STRUCTURE, UNLESS PERMITTED IN THE  
 225.30 (A) THROUGH (F)

RESIDENCE



-  DISCONNECT
-  SERVICE
-  BRANCH FEEDER (SEE NOTES)
-  SWITCH
-  OUTLET
-  CEILING FAN

# DETACHED ACCESSORY STRUCTURE WITHOUT ELECTRIC SUB-PANEL